




City of Banning

Electrical Panel Upgrade

Banning Building Department 99 E. Ramsey St.

10/6/2025 By Brian Gumpert Complete the blank lines on this sheet for sizing of wiring and conduits to submit. Statement of qualified individual is required.

Complete this form for panel replacement

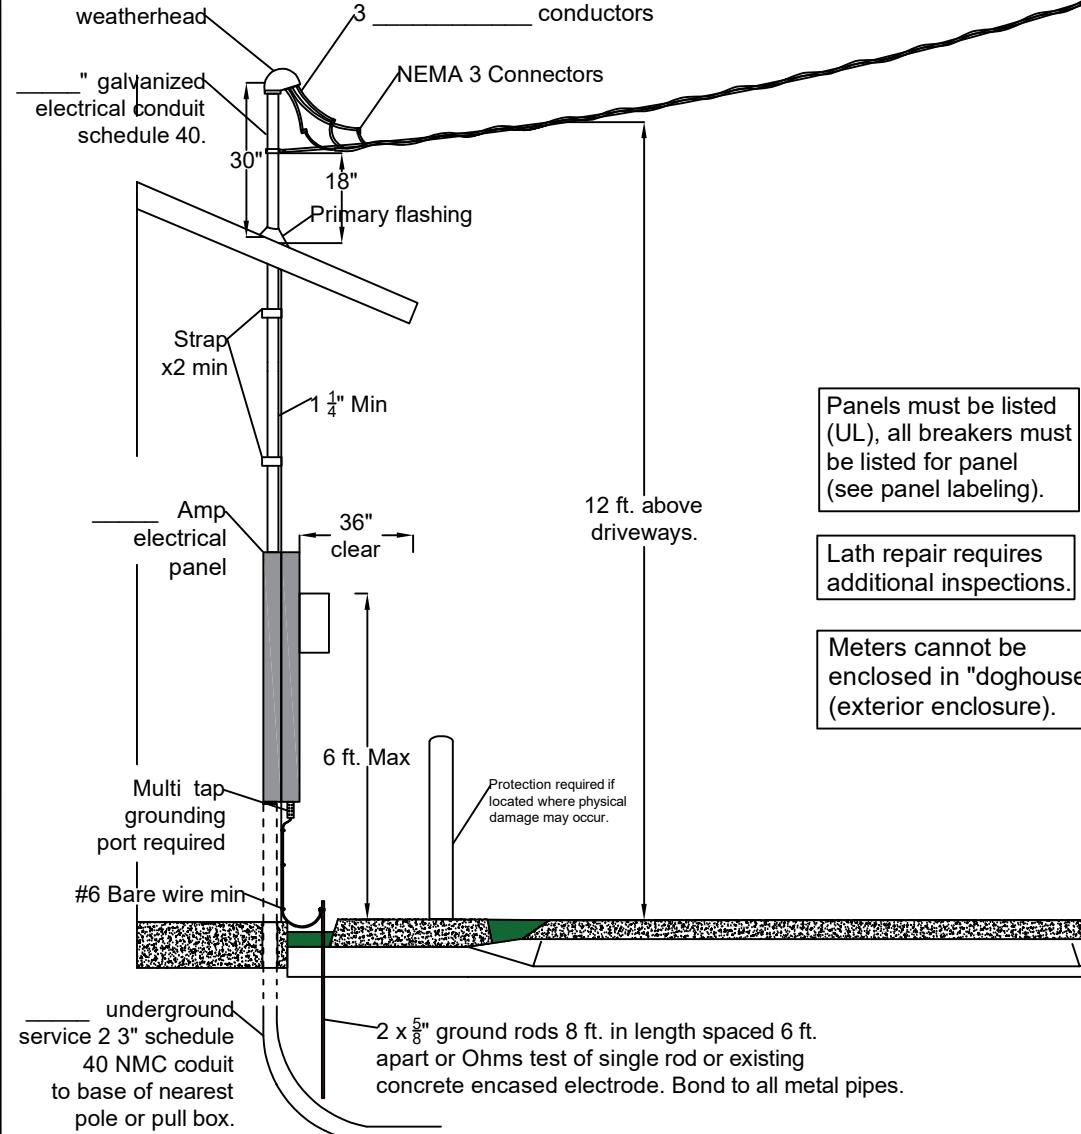

Panels must be listed (UL), all breakers must be listed for panel (see panel labeling).

Lath repair requires additional inspections.

Meters cannot be enclosed in "doghouse" (exterior enclosure).

Meter location
 Same as existing
 New (provide site plan, Banning Electrical Utility approval of location is required)